


# SERVICE LINE INVENTORY Q&A

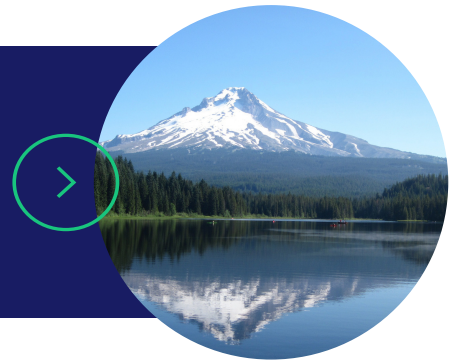

## When is the initial inventory due?

The due date is October 16, 2024.

## Can service lines be classified as non-lead based on install date?

Yes, service lines installed after 1985 (1/1/1986) are considered non-lead because this was when the state lead ban was enacted.

## How are lead goosenecks considered for service line definitions?

Lead goosenecks are NOT considered a source of lead in the definitions of lead service lines or galvanized requiring replacement.

## Can statistical analysis be used to classify unknown service lines?

Yes, but Oregon has specific requirements for this process. See "Statistical Guidance for Unknowns" in the resources below.

## Can service lines >2 inches be classified as non-lead?

Yes, any service line with a diameter of 2 inches or greater can be categorized as non-lead.

## Can water sampling be used to classify the service line?

No, lead sampling results for a home (or connection) cannot be used to determine of a lead service line for reporting on the inventory.

**For Oregon Service Line Inventory Resources, click the links below.**

- [LCR and Service Line Inventory Website](#)
- [Service Line Template CWS](#)
- [Service Line Template NTNCWS](#)
- [Service Line Inventory FAQ](#)
- [Statistical Guidance for Unknowns](#)
- [DWSRF Funding Resources](#)



**POPULATION :**

**4,241,500**

**# OF CWS :**

**924**

**#NTNCWS :**

**341**

**#CWS SERVING  
<10,000 POPULATION :**

**863**

**%CWS SERVING  
<10,000 POPULATION :**

**92%**

**POPULATION SERVED BY  
SYSTEMS SERVICE <10,000 :**

**650,906**

**# ESTIMATED LSLS :**

**3,530**

**BIPARTISAN INFRASTRUCTURE  
LAW DWSRF LEAD SERVICE LINE  
REPLACEMENT ALLOCATION :**

**\$28,650,000**



FOR MORE INFORMATION CONTACT 120WATER DIRECTOR OF WATER  
QUALITY COMPLIANCE, JONATHAN.CUPPETT@120WATER.COM



120Water™